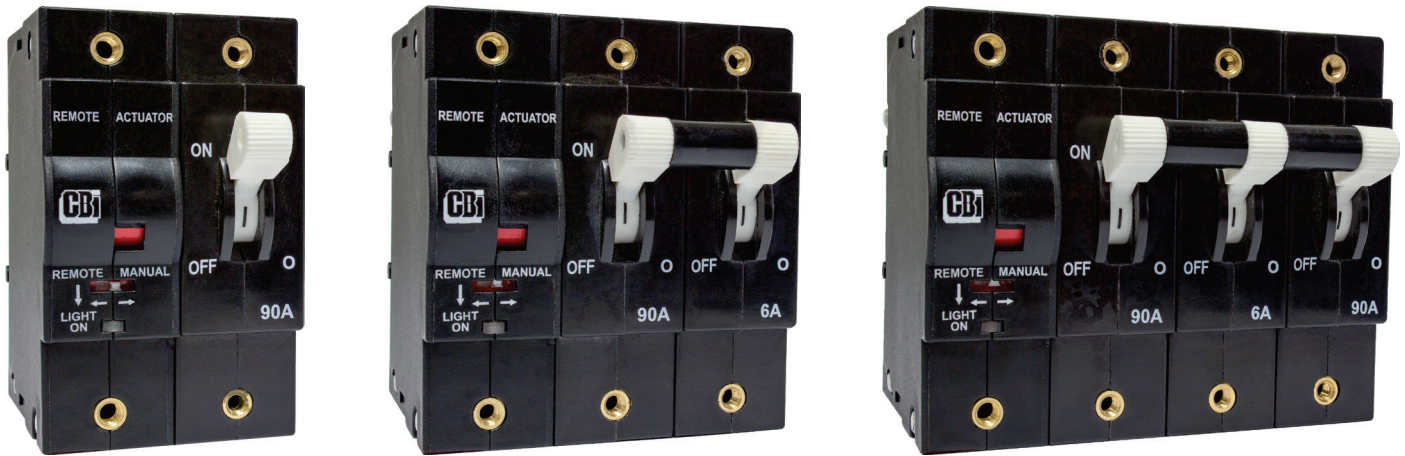


Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)



Features

- Remote actuator unit is factory-fitted on the left hand side of the DD-Frame circuit breaker
- The RAU module is designed to function on a wide voltage range: 18 Vdc to 80 Vdc
- **The RAU can be supplied from the main system voltage or a standalone source**
- The DD-Frame circuit breaker operates on the main system voltage, AC or DC
- LED for status indication
- Selectable remote or manual operation
- Provides status of the load side of the circuit breaker
- Remote switching operation requires a high or low signal
- Colour indicator for state of circuit breaker red (ON) or green (OFF)
- Actuation of circuit breaker occurs internally
- Compact size (19 mm, matching DD-Frame outline)
- Can be paired with up to a 3 pole DD-Frame circuit breaker
- **Device can be locked out to prevent manual operation**

Applications

- Battery management
- Telecommunications
- Railways
- Solar
- System automation
- Switching operations in distant, inconvenient, or unreachable environments

The remote actuation unit (RAU) is a factory-fitted module that enables the automated switching of a DD-Frame circuit breaker. The RAU internally actuates the circuit breaker both ON and OFF. The RAU is mounted on the left hand side of the circuit breaker and can actuate up to three poles. The RAU is available with circuit breakers with a standard toggle handle only. The unit has an LED that provides an indication of the mode of operation (remote or manual) and status. The second is a colour indicator which shows the position of the latching mechanism of the connected circuit breaker - green for OFF and red for ON. The RAU provides the option to set the operation mode between remote or manual. This is selected by a switch situated on the front of the RAU.

Approvals



(UL489A) (CSA C22.2 No. 5-16)



(UL489; CSA C22.2 NO.5)



(UL1077; CSA C22.2 NO.235-04)



(IEC / EN 60947-2; IEC / EN 60934)



(GB14048.2; GB17701)



(IEC 60947-2; IEC 60934)



(IEC 60947-2)

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

Technical Data

Product Type	RAU		DD Frame
Supply voltage	18 Vdc to 80 Vdc		All values as per DD Frame Circuit Breaker Data Sheet
Actuation signal voltage (For other voltages refer to page 11)	HIGH (ON)	Min. 3.3 Vdc to Max. 60 Vdc	
	LOW (OFF)	Min. 0.0 Vdc to Max. 0.5 Vdc	
Starting current	< 250 mA		
Number of poles that can be actuated	1 to 3 pole DD-Frame - factory fitted		
Ambient operating temperature	-40 °C - +65 °C		
Typical actuation time	OFF state to ON state	2 seconds	
	ON state to OFF state	1 second	
Power consumption	Idle mode	< 250 mW	
	During actuation	< 7.5 W	
Number of operations	In excess of 2000		
Flammability	I3 No flames persistence at 850 °C		
Toxicity	F2 - Smoke index of ≤ 40		
Pollution degree	PD2 - Normally only non-conductive pollution occurs. Temporary conductivity caused by condensation is to be expected.		
Signal Out Resistance to LOAD terminal	330 kΩ ±5% (2 W)		

Product Type	Circuit Breaker	Circuit Breaker	Circuit Breaker	Circuit Breaker
Approvals	IEC / EN 60947-2, GB14048.2, CE, UKCA	IEC / EN 60947-2, GB14048.2, CE, UKCA	IEC60947-2, CE, UKCA	AS/NZS 60947-2, UKCA
Number of Poles	RAU + 1, RAU + 2, RAU + 3	RAU + 2, RAU + 3	RAU + 1, RAU + 2, RAU + 3	RAU + 1, RAU + 2
Maximum Voltages	240 / 415 Vac, 80 Vdc	80 Vdc	60 Vdc	125 Vdc
Current Ratings	0.1 - 60 A(ac) 0.1 - 100 A(dc)	110 - 250 A	125 A, 250 A, 300 A	0.1 - 60 A
Ics	5 kA (DC), 1.25kA (AC)	5 kA	2.5kA	2.5kA
Icu	3 kA (AC) 5 kA (AC) 10 kA (DC)	10 kA	5 kA	5 kA

Product Type	Circuit Breaker	Circuit Breaker	Circuit Breaker
Approvals	UL489	UL489 A, CSA C22.2 No. 5-16	UL489A, CSA C22.2 No. 5-16
Number of Poles	RAU + 1, RAU + 2, RAU + 3	RAU + 1, RAU + 2, RAU + 3	RAU + 2, RAU + 3
Maximum Voltages	120 Vac, 120 / 240 Vac, 240 Vac, 80 Vdc	60 Vdc	80 Vdc
Current Ratings	0.1 - 80 A(ac) 0.1 - 100 A(dc)	125 A, 250 A, 300 A	110 - 250 A
AIC	AC - 10 kA, DC - 20 kA	14 kA	20 kA

Product Type	Circuit Breaker	Circuit Breaker
Approvals	IEC / EN 60934, CE, GB17701	UL1077, cURus
Number of Poles	RAU + 1, RAU + 2, RAU + 3	RAU + 1, RAU + 2, RAU + 3
Maximum Voltages	240 / 415 Vac, 80 Vdc	277 / 480 Vac, 80 Vdc
Current Ratings	0.1 A - 100 A (1 p), 0.1 A - 70 A (2 - 3 p)	.1 A - 100 A (1 p), 0.1 A - 70 A (2 - 4 p)
Interrupting Capacity	-	2 kA/U2/ U3 (AC) 5 kA/C1 (AC) 5 kA/U2/ U3 (DC)
Rated conditional S/C	3 kA (AC) PC1, 5 kA (DC) PC1	-
Icm	-	-

Torque Table

Description	Size	Torque Value
Front Inserts	M3	0.5 - 0.8 N.m
	6 - 32	5 - 7 lbf.in
Rear Studs	M5	2.0 - 2.8 N.m
	10 - 32	18 - 24 lbf.in
	M6	3.5 - 4.0 N.m
	1/4 - 20	30 - 35 lbf.in
Flush Rear Screws	M5	1.7 - 2.3 N.m
	10 - 32	15 - 20 N.m

Aux Switch Specification

Gold DB3	EN61058 0.1 A @ 250 Vac & 0.1 A @ 80 Vdc and UL1054 0.1 A @ 125/250 Vac & 0.1 A @ 30 Vdc & 0.3 A @ 60 Vdc
Silver DB2	EN61058 10 A @ 250 Vac & 0.1 A @ 80 Vdc and UL1054 10 A @ 125/250 Vac
Silver V4D	EN61058-1 10 A @ 250 Vac

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

Ordering Information

Group 1: Frame	Code	Description	Comments					
	D	DD-Frame RAU						
Group 2: Type	Code	Description	Comments					
	5	RAU-Lockout type (18 - 80 Vdc) Fitted on Left of Circuit Breaker	RAU D5 + 1 st Circuit Breaker pole					
	2	Additional Circuit Breaker pole	Maximum of 2 additional Circuit Breaker poles					
Group 3: Mounting	Code	Description	Comments					
	A	Front Mount, Rectangular Aperture - Standard Toggle Handle	Maximum penetration depth into the product by the mounting screw is 6mm					
Group 4: Handle Type or Blank for Reduced Handle	Code	Description	Comments					
	A	Standard Toggle Handle	Standard Toggle Handle, goes to Off Position when tripped					
Group 5: Termination	Code	Description	Comments					
	3X	Plug in (Bullet) Terminal (dia 7.8 mm x 16.4 mm)	100 A Max per terminal (80 Vdc) & 125 A Max per terminal (60 Vdc). Ensure the connector has sufficient space so as not to interfere with the terminal bar					
	4X	Flush Rear Screw Terminal, (M5 or 10 - 32)	50 A max per terminal					
	5X	Double Quick Connect Terminal (0.8 mm x 6.35 mm)	50 A Max per terminal					
	AX	Stud Terminals, (M5 or 10 - 32)	60 A Max per terminal					
	MX	Stud Terminals, (M6 or 1/4 - 20)	125 A Max per terminal					
Group 6: Total No. of Poles	Code	Description	Comments					
	2	Two pole – METRIC - RAU + 1 DD Circuit Breaker pole	Two pole modules in total					
	3	Three pole – METRIC - RAU + 2 DD Circuit Breaker poles	Three pole modules in total					
	4	Four pole – METRIC - RAU + 3 DD Circuit Breaker poles	Four pole modules in total					
	B	Two pole – IMPERIAL - RAU + 1 DD Circuit Breaker pole	Two pole modules in total					
	C	Three pole – IMPERIAL - RAU + 2 DD Circuit Breaker poles	Three pole modules in total					
	D	Four pole – IMPERIAL - RAU + 3 DD Circuit Breaker poles	Four pole modules in total					
Group 7: Rated Voltages and Frequency - Main Circuit	Code	Description	Comments					
	H	125Vdc	0.1 A - 60 A Max. (Single pole only)					
	J	120Vac, 240Vac (Applicable to Listed Single Pole DD Frame Circuit Breaker)	Refer to Certificates for Approval details					
	K	240 Vac; 277Vac (Applicable to Recognized Single Pole DD Circuit breaker)	Refer to Certificates for Approval details					
	M	AC & DC Application for Multipole Units (80 Vdc, 240Vac, 240/415 Vac & 277/480 Vac)	Refer to Certificates for Approval details					
	N	80 Vdc	Refer to Certificates for Approval details					
	R	120/240 Vac, 240 Vac, 240/415 Vac; 277/480 Vac (Applicable to Recognized Multipole Products)	Refer to Certificates for Approval details					
	S	120/240 Vac, 240 Vac or 240/415 Vac (Applicable to Listed Multipole Products)	Refer to Certificates for Approval details					
	V	60 Vdc	No Trip Alarm, Mid Trip					
Group 8: Time Delay Characteristics (Pulse Tolerance @ 10 ms)	Code	Description	System	Pulse Tolerance (X In)	Code	Description	System	Pulse Tolerance (X In)
	AD	Long delay 50 / 60 Hz AS & dual rated	AC and DC	8 - 10	CH	Short delay 50 / 60 Hz CS & high inrush	AC	12 - 15
	BD	Medium delay 50 / 60 Hz BS & dual rated	AC and DC	8 - 10	AS	Long delay 50 / 60 Hz	AC or DC	8 - 10
	CD	Short delay 50 / 60 Hz CS & dual rated	AC and DC	6 - 8	BS	Medium delay 50 / 60 Hz	AC or DC	8 - 10
	AE	Long delay 50 / 60 Hz AH & inertia delay	AC	28 - 35	CS	Short delay 50 / 60 Hz	AC or DC	6 - 8
	BE	Medium delay 50 / 60 Hz BH & inertia delay	AC	28 - 35	AW	Long delay 50 / 60 Hz AD & inertia delay	AC and DC	16 - 20
	CE	Short delay 50 / 60 Hz CH & inertia delay	AC	28 - 35	BW	Medium delay 50 / 60 Hz BD & inertia delay	AC and DC	16 - 20
	AI	Long delay 50 / 60 Hz AS & inertia delay	AC or DC	16 - 20	CW	Short delay 50 / 60 Hz CD & inertia delay	AC and DC	12 - 15
	BI	Medium delay 50 / 60 Hz BS & inertia delay	AC or DC	16 - 20	H3	Short delay	DC	6 - 8
	CI	Short delay 50 / 60 Hz CS & inertia delay	AC or DC	12 - 15	OP	Instantaneous trip 50 / 60 Hz	AC or DC	None
	AH	Long delay 50 / 60 Hz AS & high inrush	AC	16 - 20	OX	Switch 50 / 60 Hz	AC and DC	
	BH	Medium delay 50 / 60 Hz BS & high inrush	AC	16 - 20				
Group 9: Main Circuit Current	Code	Description	Comments					
	XXXX	No current, for voltage trip poles	Specific Ampere rating possible from 0.1 A to 250 A (80 Vdc) 300 A (60 Vdc)					
	100M	0.1 A						
	0100	1 A						
	1000	10 A						
	K250	250 A						

Continues on page 4

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)


Ordering Information

Code	Description	Comments
Group 10: Circuit Configuration (circuit breaker's internal construction)		
BX	Circuit Breaker (Series Trip Current Sensing)	
KX	Circuit Breaker with Auxiliary Switch	
MX	Circuit Breaker with Trip Alarm, but NO Mid Trip (Reversed Function - Latch Type)	Handle goes to OFF position when tripped and send a Trip Alarm
Group 11: Auxiliary and Alarm Switches Types & Options (Refer to Aux switch specification on page 2)		
A	DB3-Gold Tips, Equally Spaced Terminals, 2.75 mm (0.108") - EN61058 0.1 A @ 250 Vac & 0.1 A @ 80 Vdc and UL1054 0.1 A	
B	DB2-Silver Tips, Equally Spaced Terminals, 2.75mm (0.108") - EN61058 10 A @ 250 Vac & 0.1A @ 80 Vdc and UL1054 10A	
C	V4D - Silver Tips, Offset Terminals, 4.75 mm (0.189") - (10 A @ 250 Vac)	
M	Parallel Bridge Housing - For all Parallel Bridged Poles	Use M for ALL Parallel Bridged Products
X	Not Applicable	
Group 12: Voltage and Current Ratings for Dual Control, Shunt and Relay Trip Construction		
XX	Not applicable	
Group 13: Terminal Options for Dual Control, Shunt and Relay Coils		
X	Not applicable	
Group 14: Future Use		
X	Not applicable	
Group 15: Customer Specific		
X	Not applicable	
S	Customer Specific Product	
Group 16: Handle Colour		
B	Black handle, white marking.	Standard Toggle handle only
W	White handle, black marking	Standard Toggle handle only
Group 17: Handle Markings		
D	I - O/On - Off	
Group 18: Mounting Orientation for Marking		
V	Vertical, Standard Mounting, Line at the Top	
Group 19: Front Plate Marking and Test Button		
A	Standard Marking on Standard Toggle handle	I - O and ON - OFF and ampere rating
Group 20: Inter-phase Barrier and Terminal Cover		
1	Terminal cover(s)	
2	Inter-phase barrier & terminal cover - small	
3	Inter-phase barrier & terminal cover - large	
4	Inter-phase barrier & terminal cover - Z type	
A	Inter-phase barrier - small	Inter-phase barriers and terminal covers may be required for multi-pole products with UL listed and UL recognised approvals. See DD-Frame Technical Guide.
B	Inter-phase barrier - large	
C	Inter-phase barrier - Z type large	
D	Inter-phase barrier - Z type small	
X	Not applicable	
Group 21: Approvals (Product Normally Approved to)		
1	UL recognized UL1077, CUR, IEC/EN60934, CE, UKCA	Normally certified to these specifications
2	UL listed UL489, CUL, IEC/EN60947-2, CE, UKCA	Normally certified to these specifications
3	UL listed UL489A, IEC/EN60947-2, CE, UKCA	Normally certified to these specifications
Group 22: Safety Marks		
X	Not applicable	
C	GB/T 14048.2, CCC	


Verify approvals for specific ratings in accordance with the relevant test certificate

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

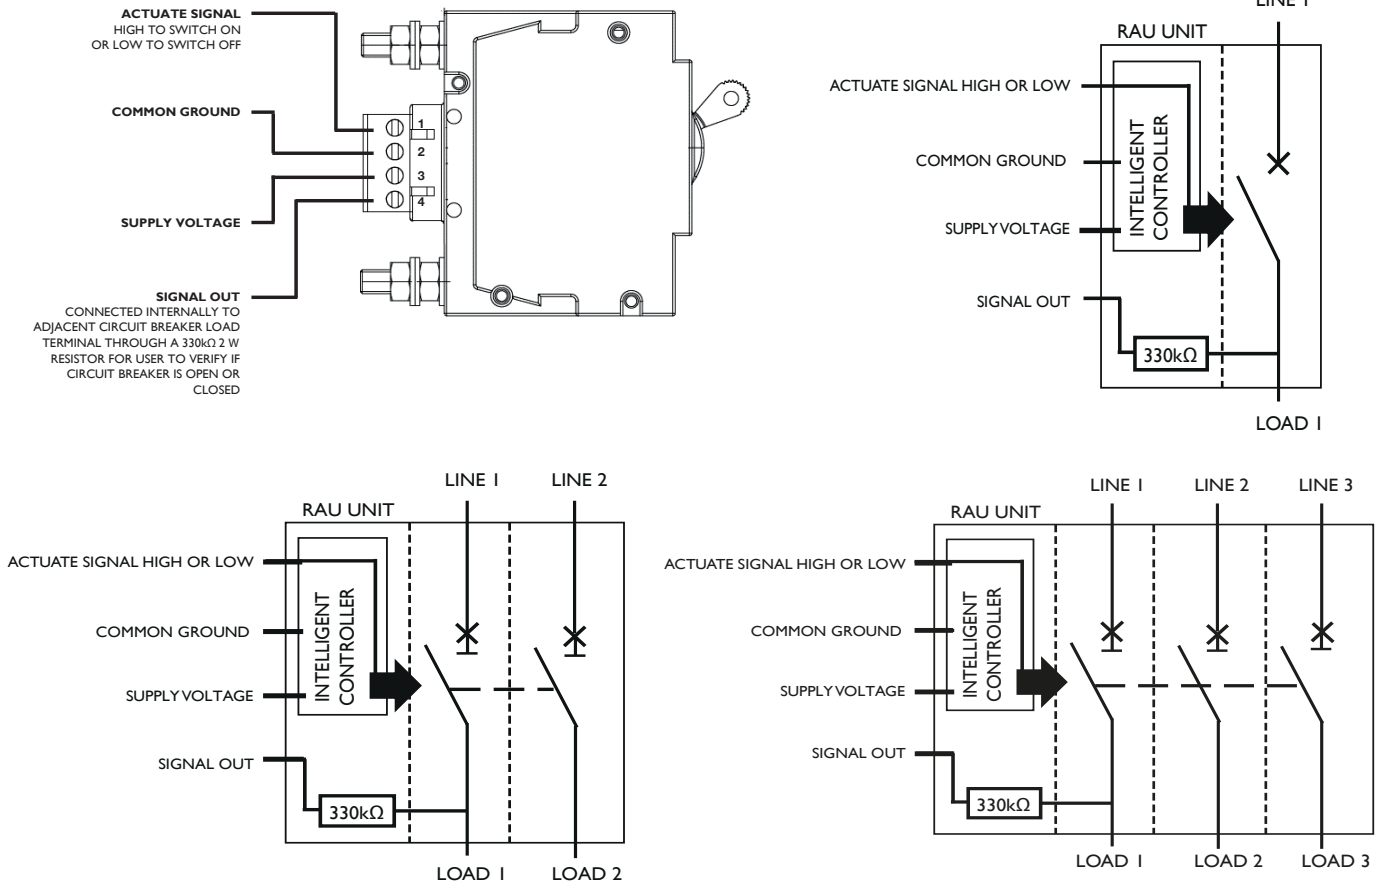Connection Diagrams




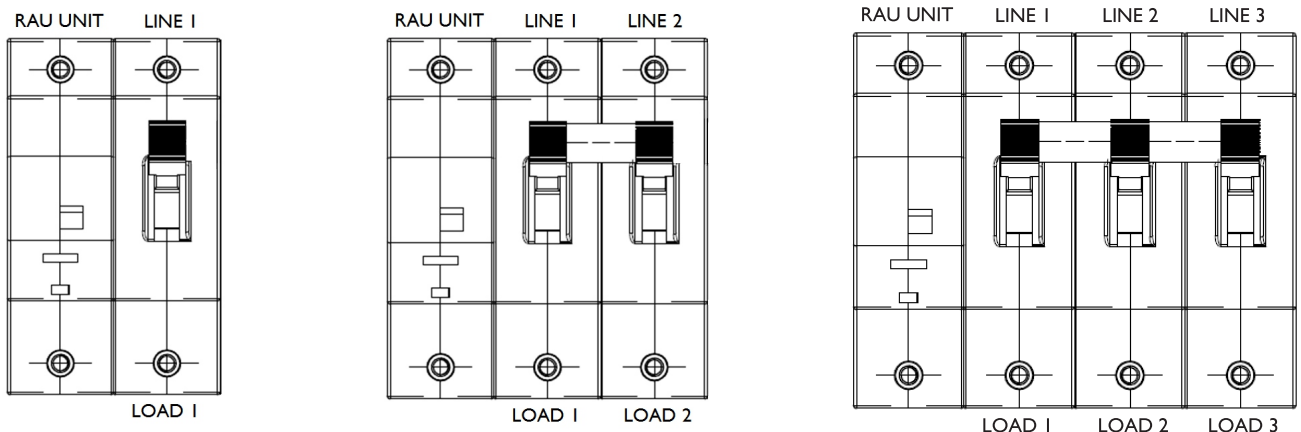Note: Signal out only provides status indication of the adjacent pole through a 330 kΩ resistor.




Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

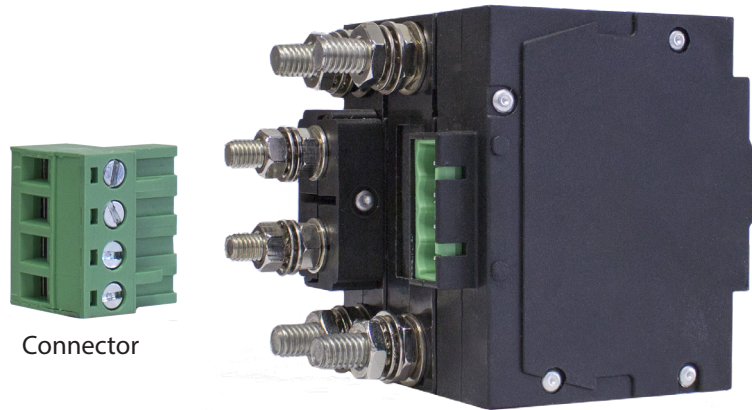Plug compatible with DEGSON 2EDGKF-5.08-04P -14 and a PHOENIX CONTACT plug 1780002.



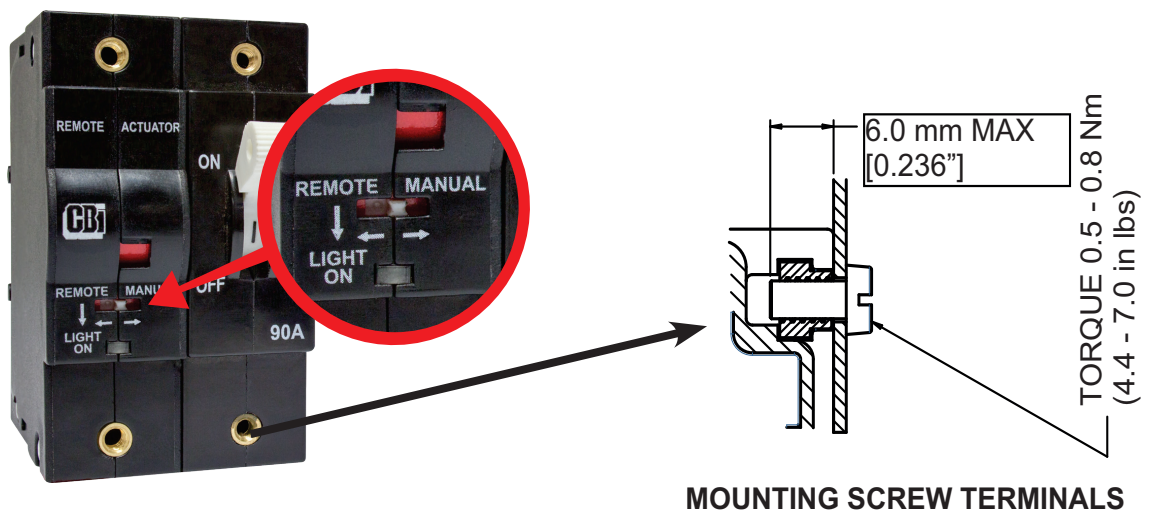The RAU front switch has two positions, namely "Remote" or "Manual". Refer to table 1 on page 7 for more details.



Installation Instructions

1. Before connecting the RAU to power, the circuit breaker must be in the OFF position and the RAU front switch must be in the REMOTE position.
2. Isolate the power to the circuit breakers.
3. Connect the circuit breakers as required and connect the necessary wiring for the RAU as shown in the connection diagram (page 5).
4. With the circuit breaker in the OFF position, activate the supply to the circuit breakers and the RAU. The LED on the RAU will flash 3 times during its initialisation process. The LED will then illuminate, indicating that the RAU is now ready for operation.

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

Remote Operation

Set the front switch to REMOTE to enable remote operation. The LED will be illuminated

1. Switching the circuit breaker ON using the RAU:

- Set the actuate signal HIGH. This will switch the circuit breaker ON remotely. While the actuate signal remains in the HIGH state, the circuit breaker can be operated manually like a conventional circuit breaker.

2. Switching the circuit breaker OFF using the RAU:

- Set the actuate signal LOW. This will switch the circuit breaker OFF. While the actuate signal is LOW, the circuit breaker will be internally held in the tripped position and cannot be switched ON manually.

3. If the circuit breaker trips, then to remotely switch the breaker ON again, the Actuate Signal must be set to LOW and then a HIGH signal must be reapplied.

NOTE:

- DO NOT move or block the circuit breaker handles while the RAU is actuating remotely.
- DO NOT change the state of the actuate signal or RAU front switch rapidly, or while the circuit breaker is in motion, allow atleast a 3 seconds waiting period before changing the state.

Manual Operation

Set the front switch to MANUAL to disable remote operation. Manual mode prevents the breaker from automatically turning on.

Changes to the remote signal enables or disables the lock-out features:

A breaker that was manually turned on, will trip to lock out if the remote signal goes LOW. The LED blinks to indicate this state.

If subsequently the actuation signal goes HIGH, manual operation becomes possible again.

The breaker will not turn on automatically while manual - only unlock internally

The feature ensures that lock-out can always be enforced when required

The RAU Operation

The RAU will trip the circuit when the RAU front switch is toggled. RAU operation can be described in terms of changing states based on the remote signal or the front switch. The various states are as follows:

Table 1: RAU front switch and operation states

Initial State					Change		Response	
State	Signal	Switch	LED	Manually Operable	Signal	Switch	RAU Action	New State
A	HIGH	REMOTE	ON	Yes	to LOW		turns off and block manual operation	C
						to MANUAL	turns off to enter manual	B
B	HIGH	MANUAL	OFF	Yes	to LOW		turns off and block manual operation	D
						to REMOTE	turns off, then turns on to enter remote	A
C	LOW	REMOTE	ON	No	to HIGH		turns on	A
						to MANUAL	remians blocked in off position	D
D	LOW	MANUAL	Blink	No	to HIGH		unlock maunal operation	B
						to REMOTE	enter remote mode in off position	C

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

LED Status Indication

LED State	Indication
Flash 3 times	Initialisation
Flash 3 times every 4 seconds	Fault state
ON	Remote actuation mode
OFF	Manual operation mode
Blinking	User will not be able to switch breaker on manually
2 Short flash & 1 long flash	Initialisation fault

Application Notes:

RAU powered from Negative DC Bus

The DD-frame RAU requires a positive supply voltage between 18 Vdc and 80 Vdc to operate, however, systems may only have a negative voltage supply available. The RAU is able to accommodate such environments. Figure 1 shows an example of an RAU in a telecommunications applications which only has a -48 Vdc bus voltage available. Resistor R is required if the potential difference between the Actuate Signal pin and the Common pin is greater than 60 Vdc.

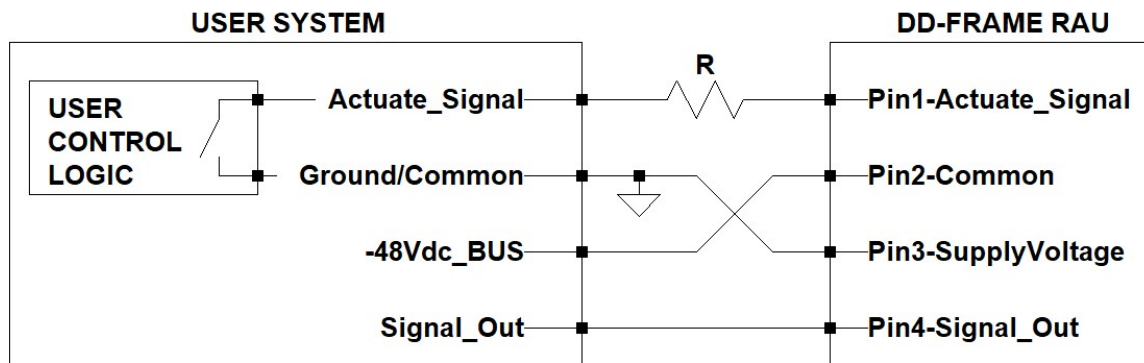


Figure 1: Wiring diagram example for DD-Frame RAU powered from negative supply bus in a -48 Vdc telecommunications application

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)









Using the Signal Out

Signal out can have many functions and is not just an auxiliary contact to indicate the open / closed state of the circuit breaker. The signal out function will depend on its specific application. This application note will convey the function of signal out for various applications under resistive loads only.









The signal out contact is connected only to the adjacent pole LOAD side and is isolated from the control.

Note that the signal out will vary depending on the type of load and will need to be taken into consideration when designing the RAU into a system.

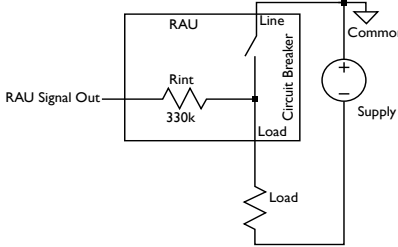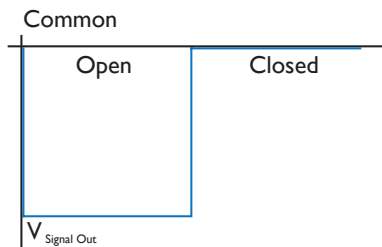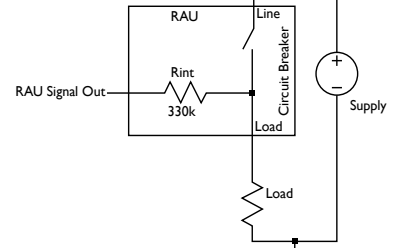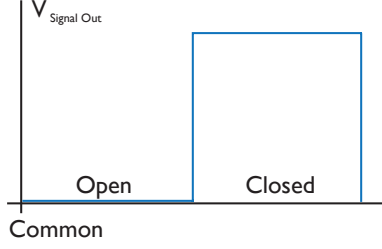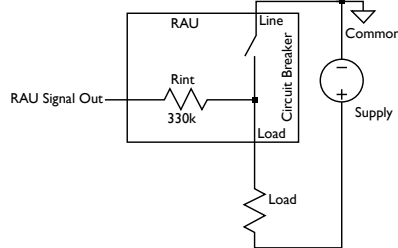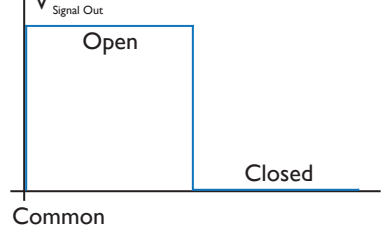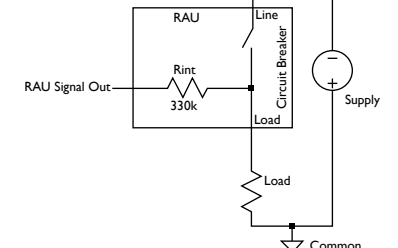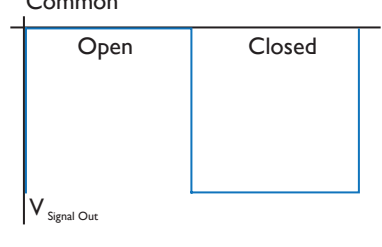Table 2: Wiring Configuration

Wiring Configuration	Signal Out with reference to common when circuit breaker is open or closed	Purpose of Signal out
		Monitor status of circuit breaker
		Monitor status of circuit breaker
		Monitor status of circuit breaker
		Monitor status of circuit breaker

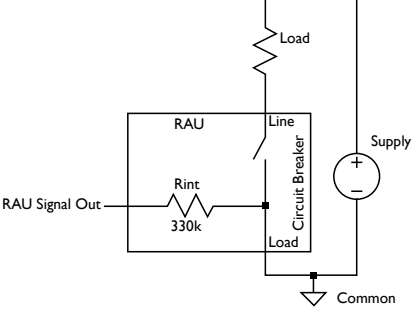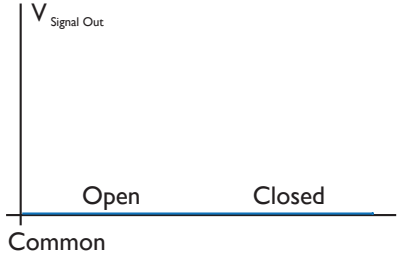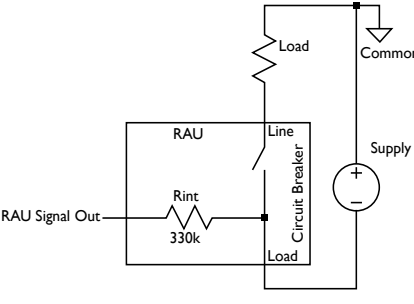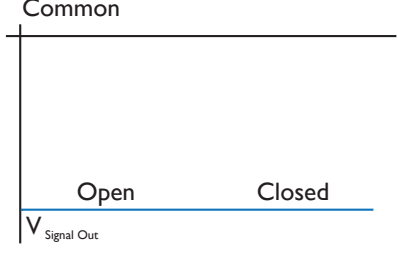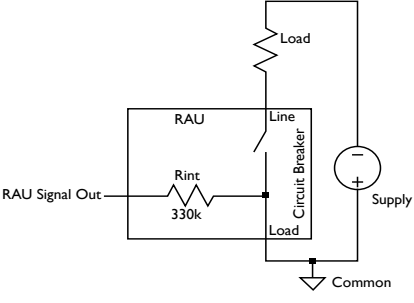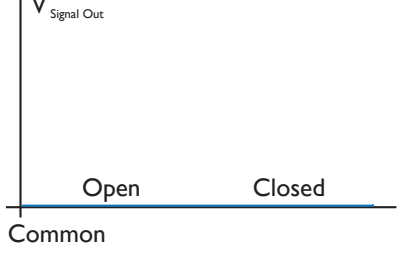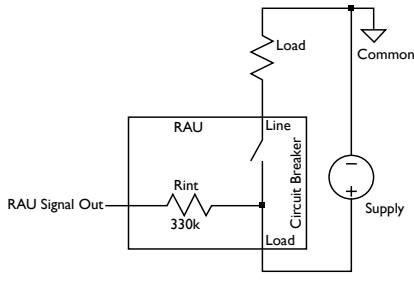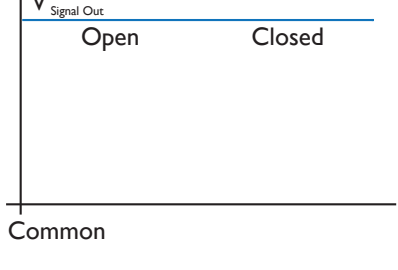Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

Wiring Configuration	Signal Out with reference to RAU Common	Purpose of Signal out
		Common potential monitoring
		Monitor Supply
		Common potential monitoring
		Monitor supply

Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

Actuation Signal Voltage Greater than 60 Vdc

The maximum actuation signal voltage that can be applied to the DD-Frame RAU is 60 Vdc. If the application is such that the actuation signal voltage will be larger than 60 Vdc, then an external resistor must be added in series as indicated in figure 2.

The value of the resistor can be designed for using the following equation:

$$R = \left(\frac{V_{\text{supply}} - 60}{0.001} \right) \text{ with deviation of } \pm 20\%$$

For example, if the actuation signal voltage will be 72 Vdc, then a 12 kΩ resistor must be added in series. See table 3.

External resistor to add in series for actuation signal voltage above

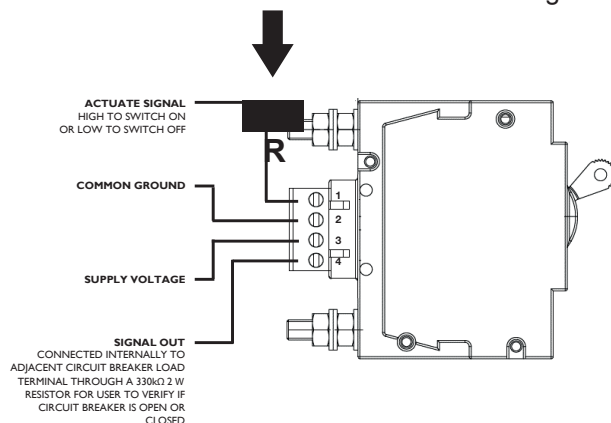



Figure 2: Side view of DD-Frame RAU indicating how to add resistor in series for actuation signal voltages above 60 Vdc

Table 3: Actuation signal voltages and corresponding resistor values to be added in series

Actuation Voltages in Volts dc	External resistor to add in series with actuate terminal (E12 series)
72	12 kΩ
80	22 kΩ


Alternatively, a voltage divider may be implemented to create a signal voltage between 5 Vdc and 60 Vdc. The minimum current required by the actuation signal input is 5 mA.

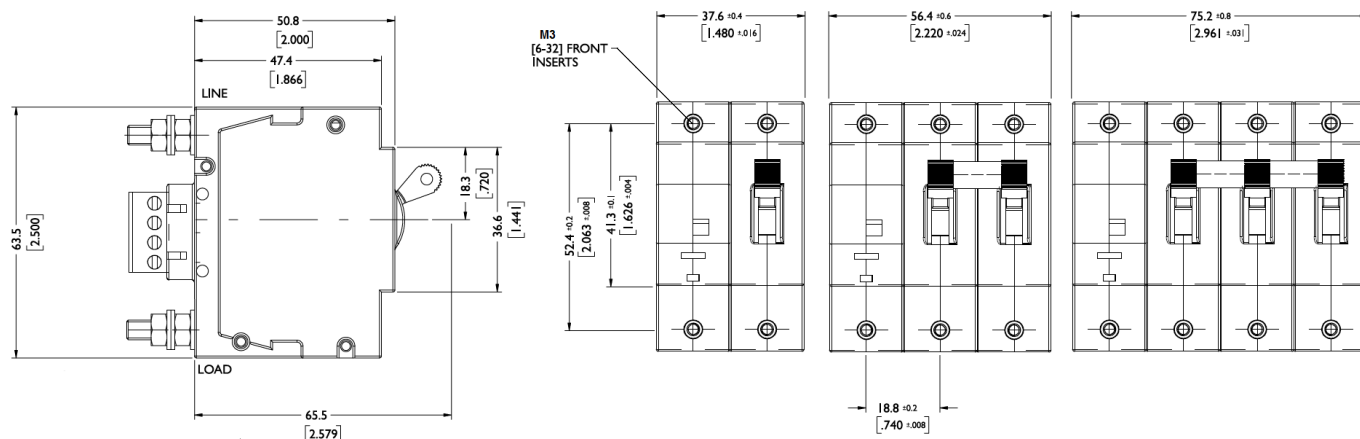Dimensional Drawings





Remote Actuator Unit (RAU) with Lockout for DD-Frame (D5)

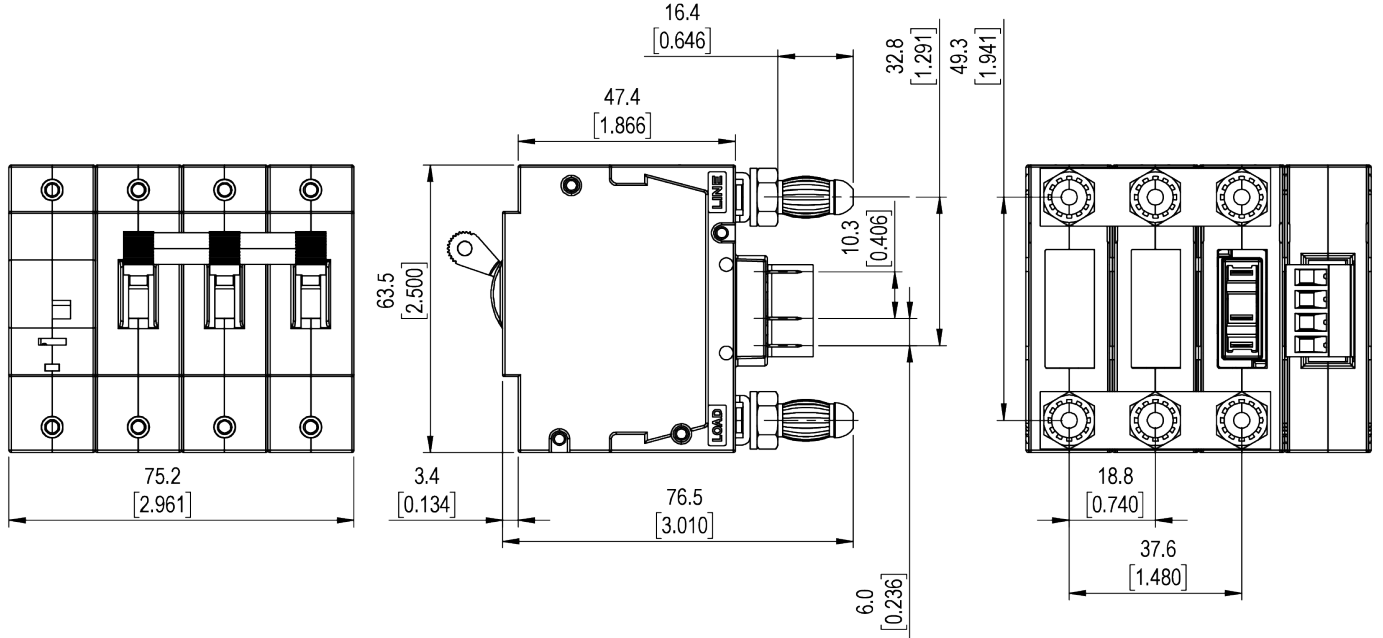Outline Dimensions: Panel Cutout Standard Handle



NOTES:

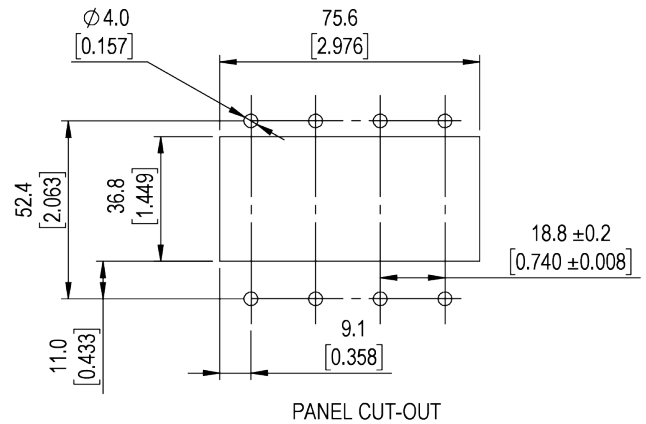1. TOLERANCE $\pm 0.4\text{MM}$ UNLESS STATED.
2. ALL DIMENSIONS IN BRACKETS ARE IN INCH.



PLUG-IN MATING HOLE

PLUG IN TYPE SIZE	A	B	C	D
PLUG IN LARGE (7.80mm DIA)	24.3 [0.957]	16.4 [0.646]	7.80 [0.307]	7.95 [0.313]

* Other plug-in version available on special request up to 80 A

Please review our Customer Terms and Conditions on www.cbi-lowvoltage.co.za

© CBI (Pty) Ltd. All Rights Reserved.

All rights reserved. Unless otherwise indicated, all materials on these pages are copyrighted by CBI (Pty) Ltd. No part of these pages, either text or image may be used for any purpose other than personal use. Therefore, reproduction, modification, storage in a retrieval system or retransmission, in any form or by any means, electronic, mechanical or otherwise, for reasons other than personal use, is strictly prohibited without prior written permission. CBI (Pty) Ltd reserves the right to alter any details of this document without notice and while every effort is made to ensure the accuracy of the content, no warranty is given as to the accuracy of this document and no responsibility will be accepted for error or misinterpretation and any resulting loss.

AUSTRALIA

CBI-electric: Australia
27 Wedgewood Rd, Hallam
Victoria 3803 Australia
Tel: +61 3 8752 9300
Fax: +61 3 9796 5407
Email: sales@cbi-electric.com.au
Website: www.cbi-electric.com.au

INDIA

CBI-electric: Asia
A1, Pushpagiri Residency, 1st Cross
2nd Main, Jyothi Nagar, B.G Road
Bengaluru 560083, India
Tel: +91-9880553153
Email: salesasia@cbi-electric.com
Website: www.cbibreakers.com
Website: www.cbi-lowvoltage.com

SOUTH AFRICA

CBI-electric: low voltage
Tripswitch Drive Elandsfontein
Gauteng South Africa
Tel: +27 11 928 2000
Fax: +27 11 392 2354
Email: cbi@cbi-electric.com
internationalsales@cbi-electric.com
Website: www.cbi-lowvoltage.com

USA

CBI-electric: North America
35 E. Uwchlan Ave Suite 328
Exton PA 19341 USA
Tel: +1 610 524 9949
Fax: +1 610 524 9945
E-mail: info@cbibreakers.com
Website: www.cbibreakers.com